



MODEL T-260 TOWER SPECIFICATIONS





TOWER SPECIFICATIONS: MODEL T-260 Cooling Tower Systems, Inc.

Design and Operating Conditions		Water Distribution System Construction Materials	
Tower Type:	Counter Flow Induced Draft	Stand Pipe:	PVC
Water Flow Rate (GPM):	177 GPM	Sprinkler Head:	AC
Entering Water Temperature	95°F	Sprinkler Pipes:	PVC
Leaving Water Temperature	85°F	Mechanical Equipment	
Wet Bulb Temperature:	75°F	Fan Unit:	One Unit per Tower
Total Fan BHP:	1.5 HP	Type:	Axial Flow
Total Pump Head:	6.6'	Manufacturer:	CTS
Drift Loss of Water Flow:	0.1%	Diameter:	46"
Evaporation Loss of Water Flow:	0.93%	Blade Material:	AC
Design Wind Load:	30.7 lbs/sq. ft.	Hub Material:	AC
Structural Details		Nominal Air Volume:	14,700 CFM
Overall Diameter:	78 3/4"	Fan Motor	
Overall Height:	74 11/16"	Number of motors:	One Unit per Tower
Dry Weight:	504 lbs.	Type:	Induction
Operating Weight:	1,472 lbs.	Manufacturer:	CTS
Basic Tower Construction Materials		Insulation:	F Class
Tower Support Frame Assembly	-	Rated HP:	1.5 HP
Casing:	FRP	Voltage and phase:	220/440V/3
Casing Supporters	Nylon	Piping Connections	
Cold Water Basin	FRP	Primary Water Inlet Diameter	3"
Filling:	PVC	Primary Water Outlet Diameter:	3"
Filling Supports:	HDGS	Auto fill inlet diameter:	3/4"
Fan Guard	HDGS	Quick fill inlet diameter:	-
Mechanical Equipment Supports:	HDGS	Overflow outlet diameter:	1"
Inlet Louvers:	PVC	Drain diameter:	1"
Bolts, Nuts & Washers:	STS	Water Flow (GPM):	177 GPM
Materials Key			
FRP	Fiberglass Reinforced Polyester	STS	Stainless Steel
HDGS	Hot Dipped Galvanized Steel	AC	Aluminum Alloy Cast

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905

F: 478.755.8304

www.coolingtowersystems.com

info@coolingtowersystems.com



Cooling Tower Systems, Inc.

PARTS LIST: MODEL T-260

FOR ASSEMBLY DIAGRAM			FOR TECHNICAL DIAGRAMS			
Ref. No.	Description	QTY	Item No.	Description	Material	QTY
02-01	Water Sump	1	1	Fan Motor	-	1 pcs
02-02	Outlet Nozzle	1	2	V-Belt Reducer	-	-
02-03	Inlet Nozzle	1	3	Motor Frame Assembly	HDGS	1 set
02-04	Over Flow Nozzle	1	4	Fan Blade Assembly	AC	1 set
02-05	Drain Nozzle	1	5	Fan Guard	HDGS	1 set
02-06	Automatic Filler Nozzle	1	6	Casing	FRP	4 pcs
02-07	Quick Filler Nozzle	1	7	Hand Hole	EVA	1 pcs
02-08	Float Valve Assembly	1	8	Sprinkler Head	Nylon	1 set
02-09	Over Flow	1	9	Sprinkler Pipes	PVC	4 pcs
02-10	Suction Strainer	1	10	Eliminator	PVC	4 pcs
02-12A	Z Type Connector	1	11	Tension Device	-	-
02-16	Elbow	1	12	Stand Pipe	PVC	1 set
02-19	Inlet Pipe	1	13	Filling	PVC	1 set
03-01	Water Basin	2	14	Stopper or Column	AC	1 set
04-00	Casing Supporter	4	15	Filling Supporter	HDGS	1 set
05-01A	Casing	4	16	Casing Supporter	Nylon	4 pcs
05-06	Hand Hole Cover	1	17	Inlet Louver	PVC	1 set
06-01	Stand Pipe	1	18	Frame Assembly	-	-
06-04	Stand Pipe Base	1	19	Water Basin	FRP	2 pcs
07-01	Stopper	1	20	Water Sump	FRP	1 pcs
08-01	Filling Supporter - A	4	21	Ladder	HDGS	1 set
08-02	Filling Supporter - C	4	22	Strainer	PE	1 pcs
10-00	Ladder	1	23	Flange	-	-
10-03	Ladder Bracket - A	2	24	Basin Supporter	-	-
10-04	Ladder Bracket - B	2				
11-00	Filling	2				
12-01	Sprinkler Head	1				
12-04	Tension Wire	2				
13-01	Sprinkler Pipe	4				
13-02	End Cap	4				
13-03	Eliminator	4				
13-04	Lock Nut	4				
14-00	Motor Frame Assembly	1				
16-01	Fan Motor	1				
16-03	Fan Key	1				
16-04	Fasten Nut	1				
17-00	Fan Assembly	1				
17-01	Fan Hub	1				
17-02	Fan Blade	4				
17-04	U-Bolt	8				
18-01	Fan Guard	2				
20-02	Inlet Louver	5				
20-03	PVC Frame	10				
20-04	Louver Clip	8				
20-05	Louver Plate	8				
20-06	Lug Plate	8				
OTHERS	Bolts & Nuts	1 SET				

Materials Key	
FRP	Fiberglass Reinforced Polyester
HDGS	Hot Dipped Galvanized Steel
STS	Stainless Steel
AC	Aluminum Alloy Cast

Water Basin Sealing Material	
Fiberglass	1 Set—A
Polyester Resin	1 Keg—B
Catalyst	1 Bottle—C

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201


TF: 800.752.1905

F: 478.755.8304

www.coolingtowersystems.com

info@coolingtowersystems.com

ASSEMBLY DIAGRAM: MODEL T-260

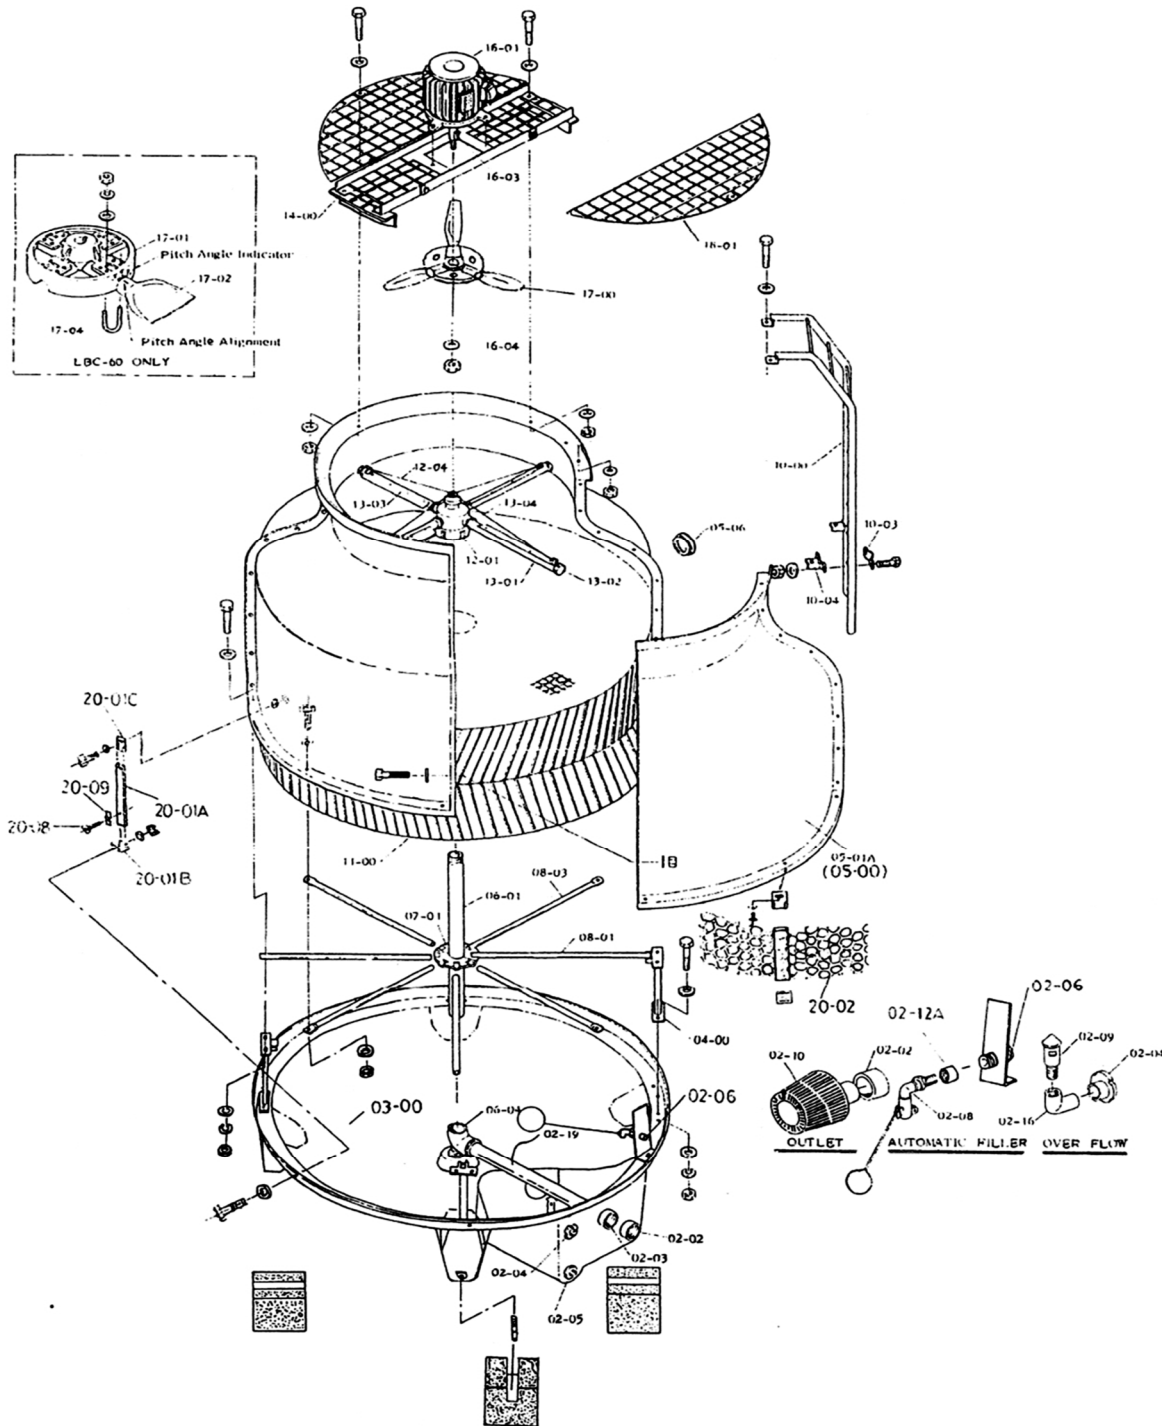

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905

F: 478.755.8304


www.coolingtowersystems.com

info@coolingtowersystems.com



TECHNICAL IMAGE A: MODEL T-260

Cooling Tower Systems, Inc.

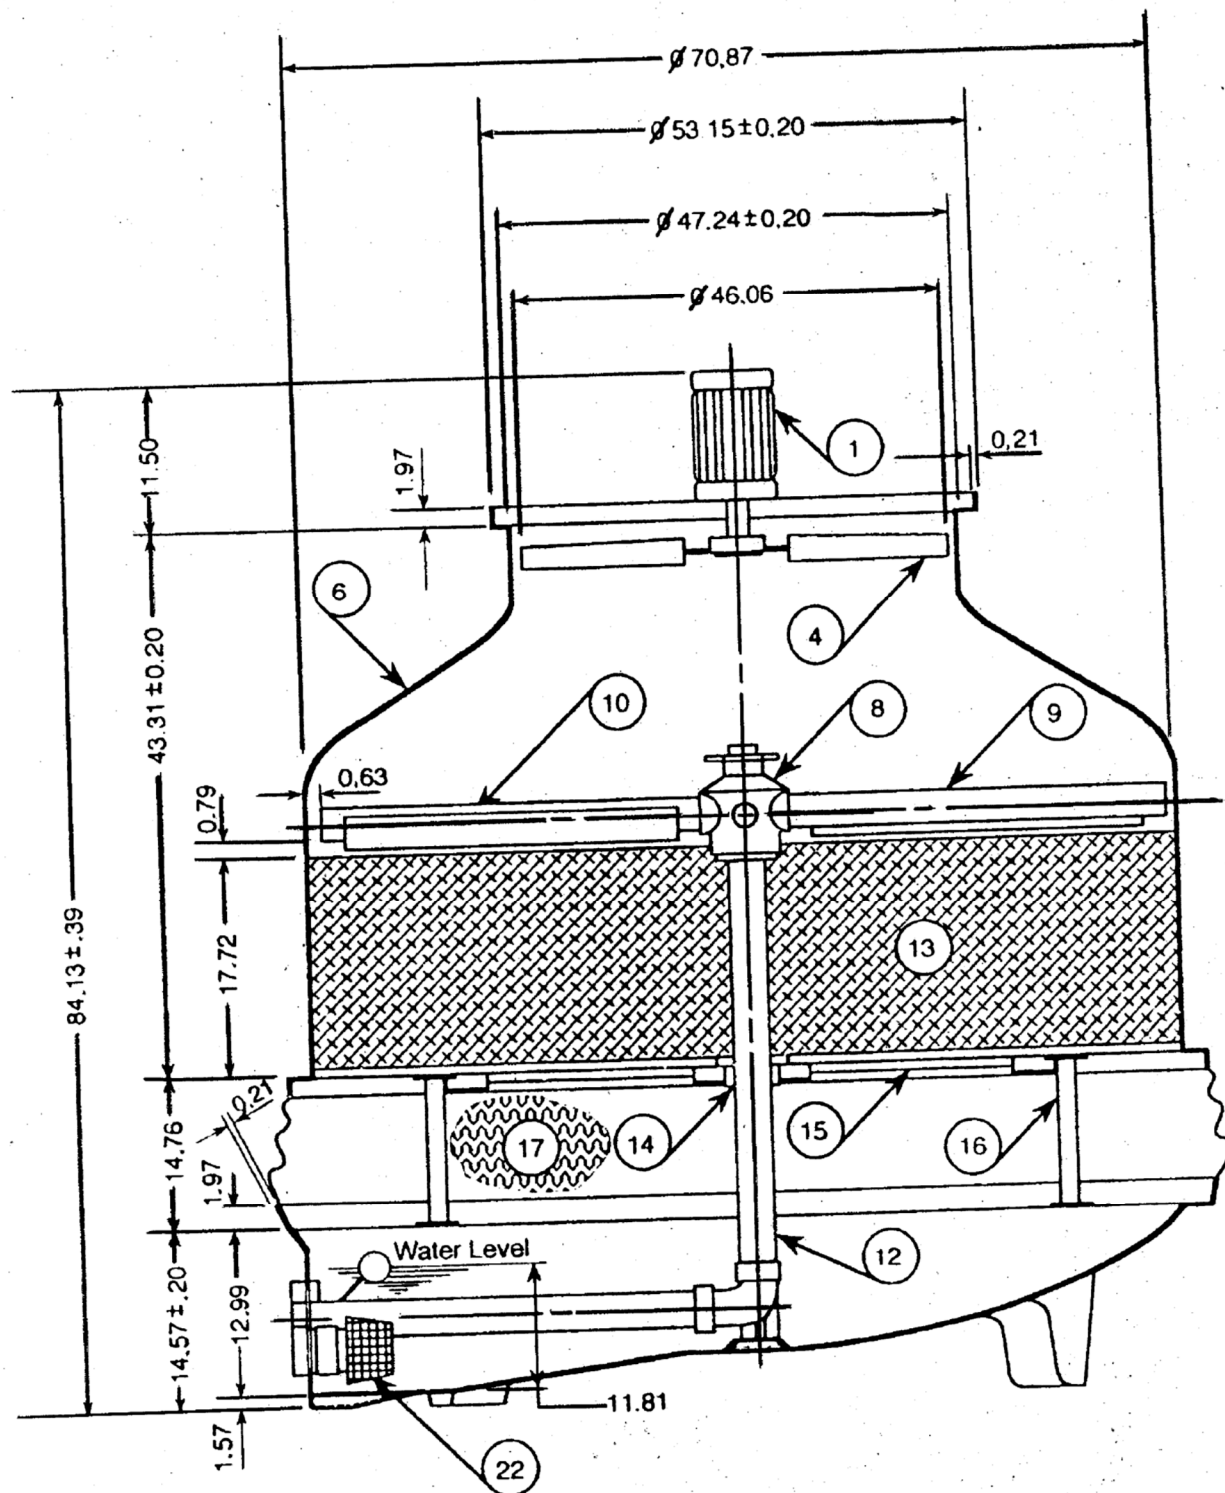

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905


F: 478.755.8304

www.coolingtowersystems.com

info@coolingtowersystems.com



TECHNICAL IMAGE C & D: MODEL T-260 Cooling Tower Systems, Inc.

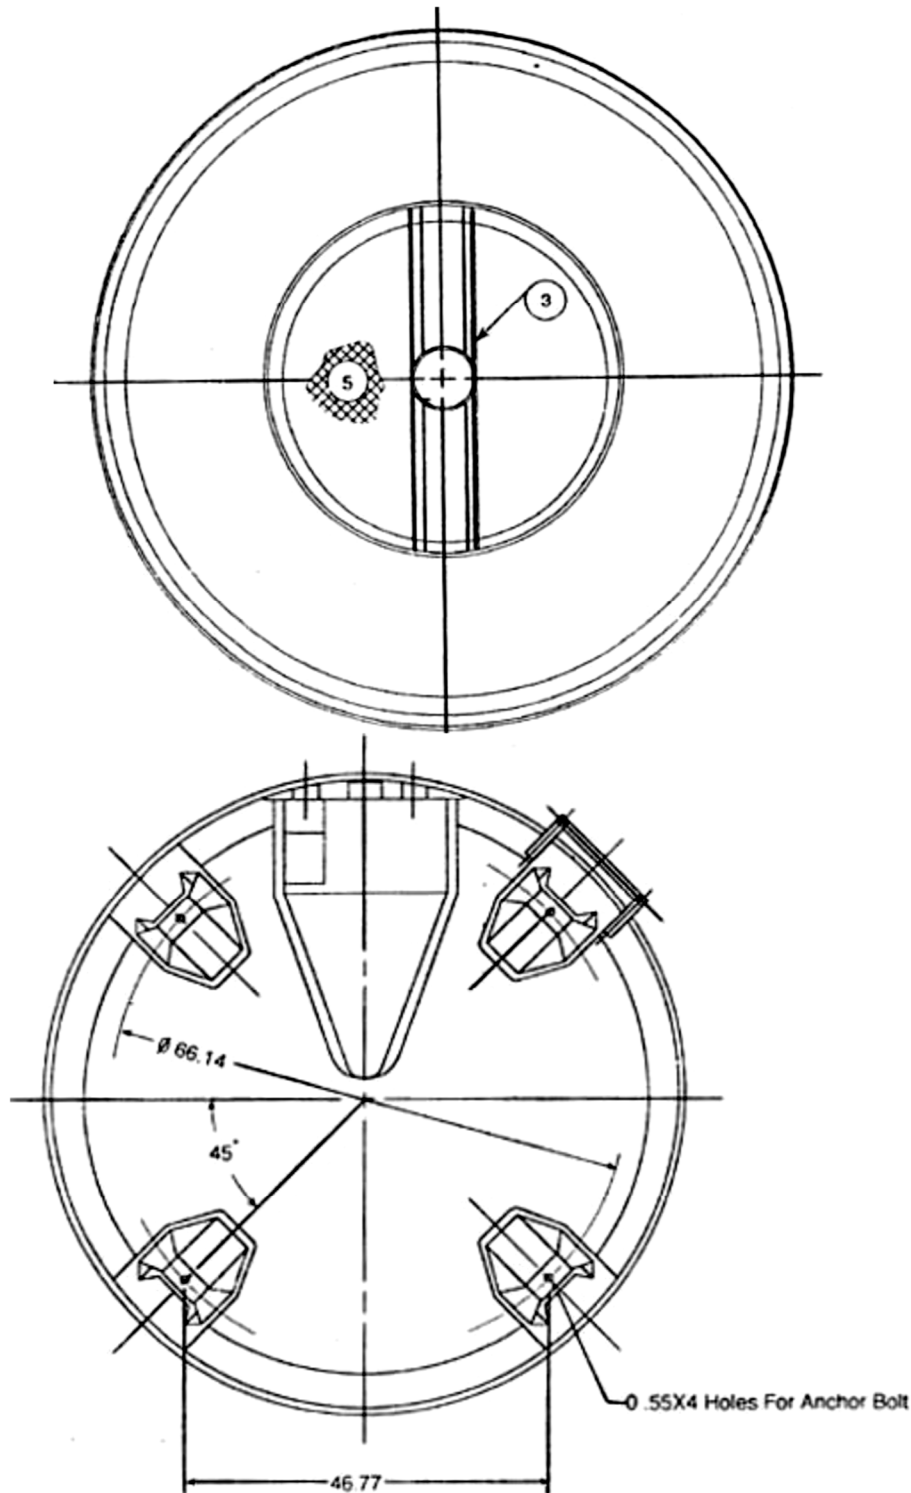

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905

F: 478.755.8304


www.coolingtowersystems.com

info@coolingtowersystems.com



TECHNICAL IMAGE D: MODEL T-260

Cooling Tower Systems, Inc.

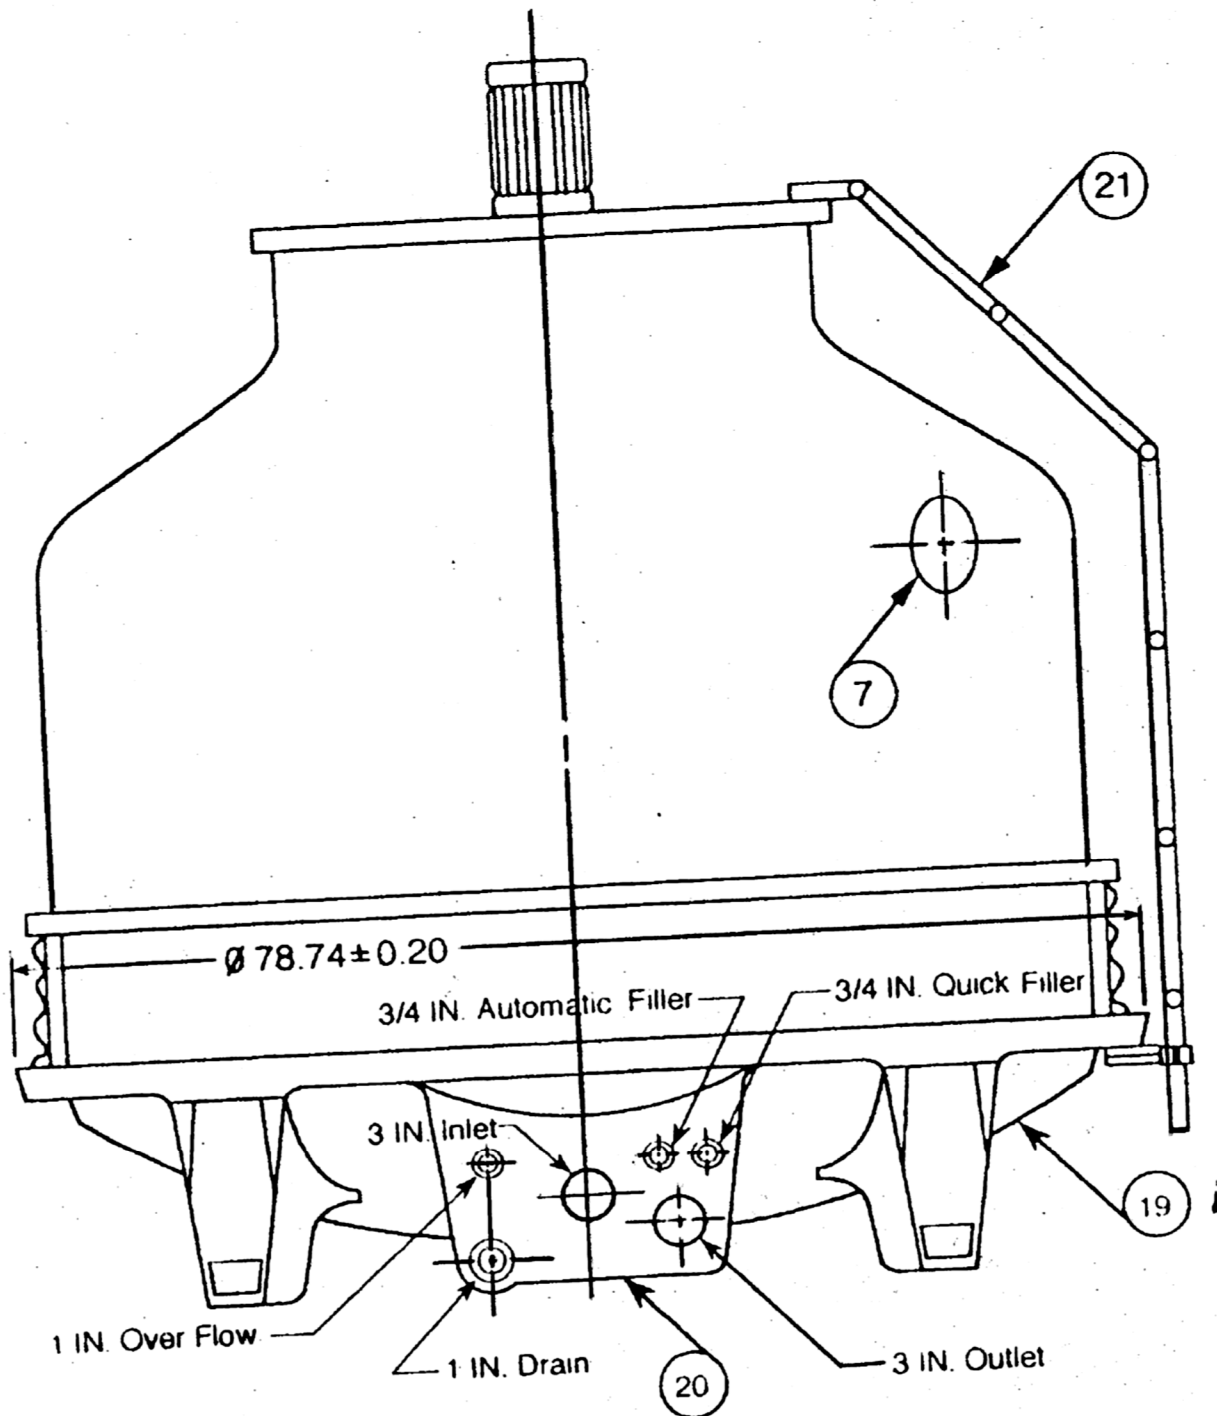

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905


F: 478.755.8304

www.coolingtowersystems.com


info@coolingtowersystems.com

FOUNDATION DRAWING: MODEL T-260 Cooling Tower Systems, Inc.

T-	ϕD	W	L TYPE ANCHOR BOLT		
			SIZE	L	PCS
240	57 7/8	40 7/8	W1/2	5	4
250	66 1/8	46 3/4	W1/2	5	4
260	66 1/8	46 3/4	W1/2	5	4

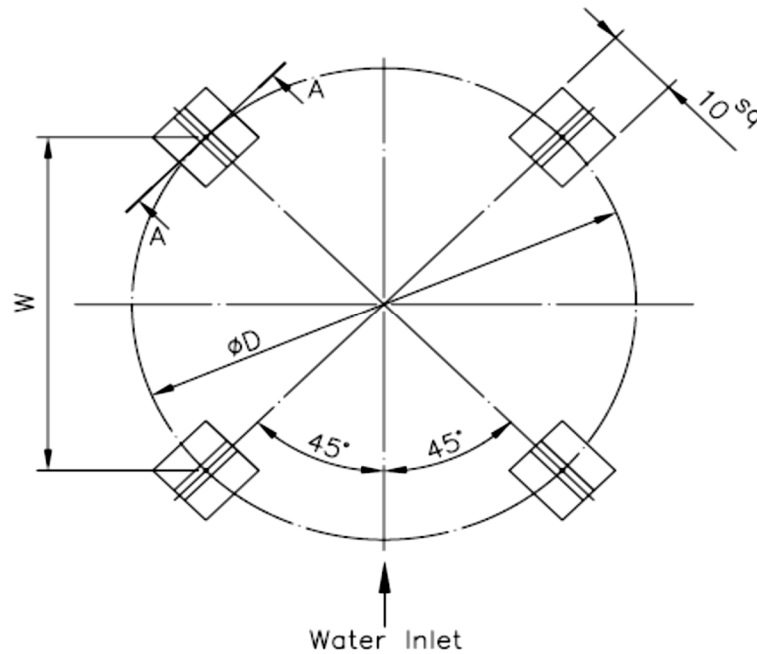

1 1/4L ALL THREAD PROJECTION
W1/2x5L, L TYPE ANCHOR BOLT 4PCS

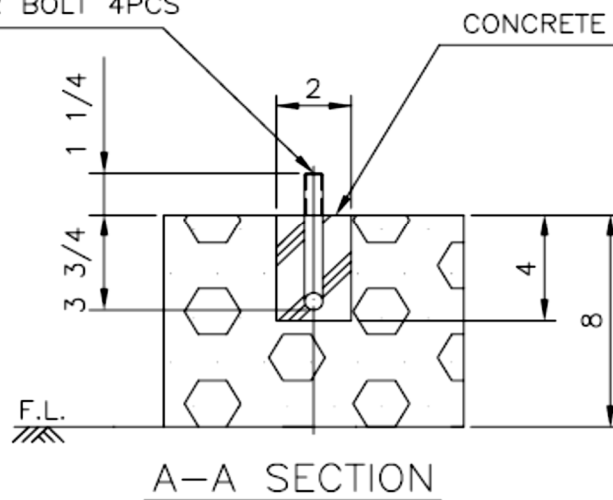

Cooling Tower Systems, Inc.

196 Lower Cherry Street Macon, GA 31201

TF: 800.752.1905

F: 478.755.8304

www.coolingtowersystems.com

info@coolingtowersystems.com